



# Final Corridor & Preliminary Alternative Corridors Map

Greensboro-Randolph Megasite 100kV Transmission Line Siting Study | North Carolina

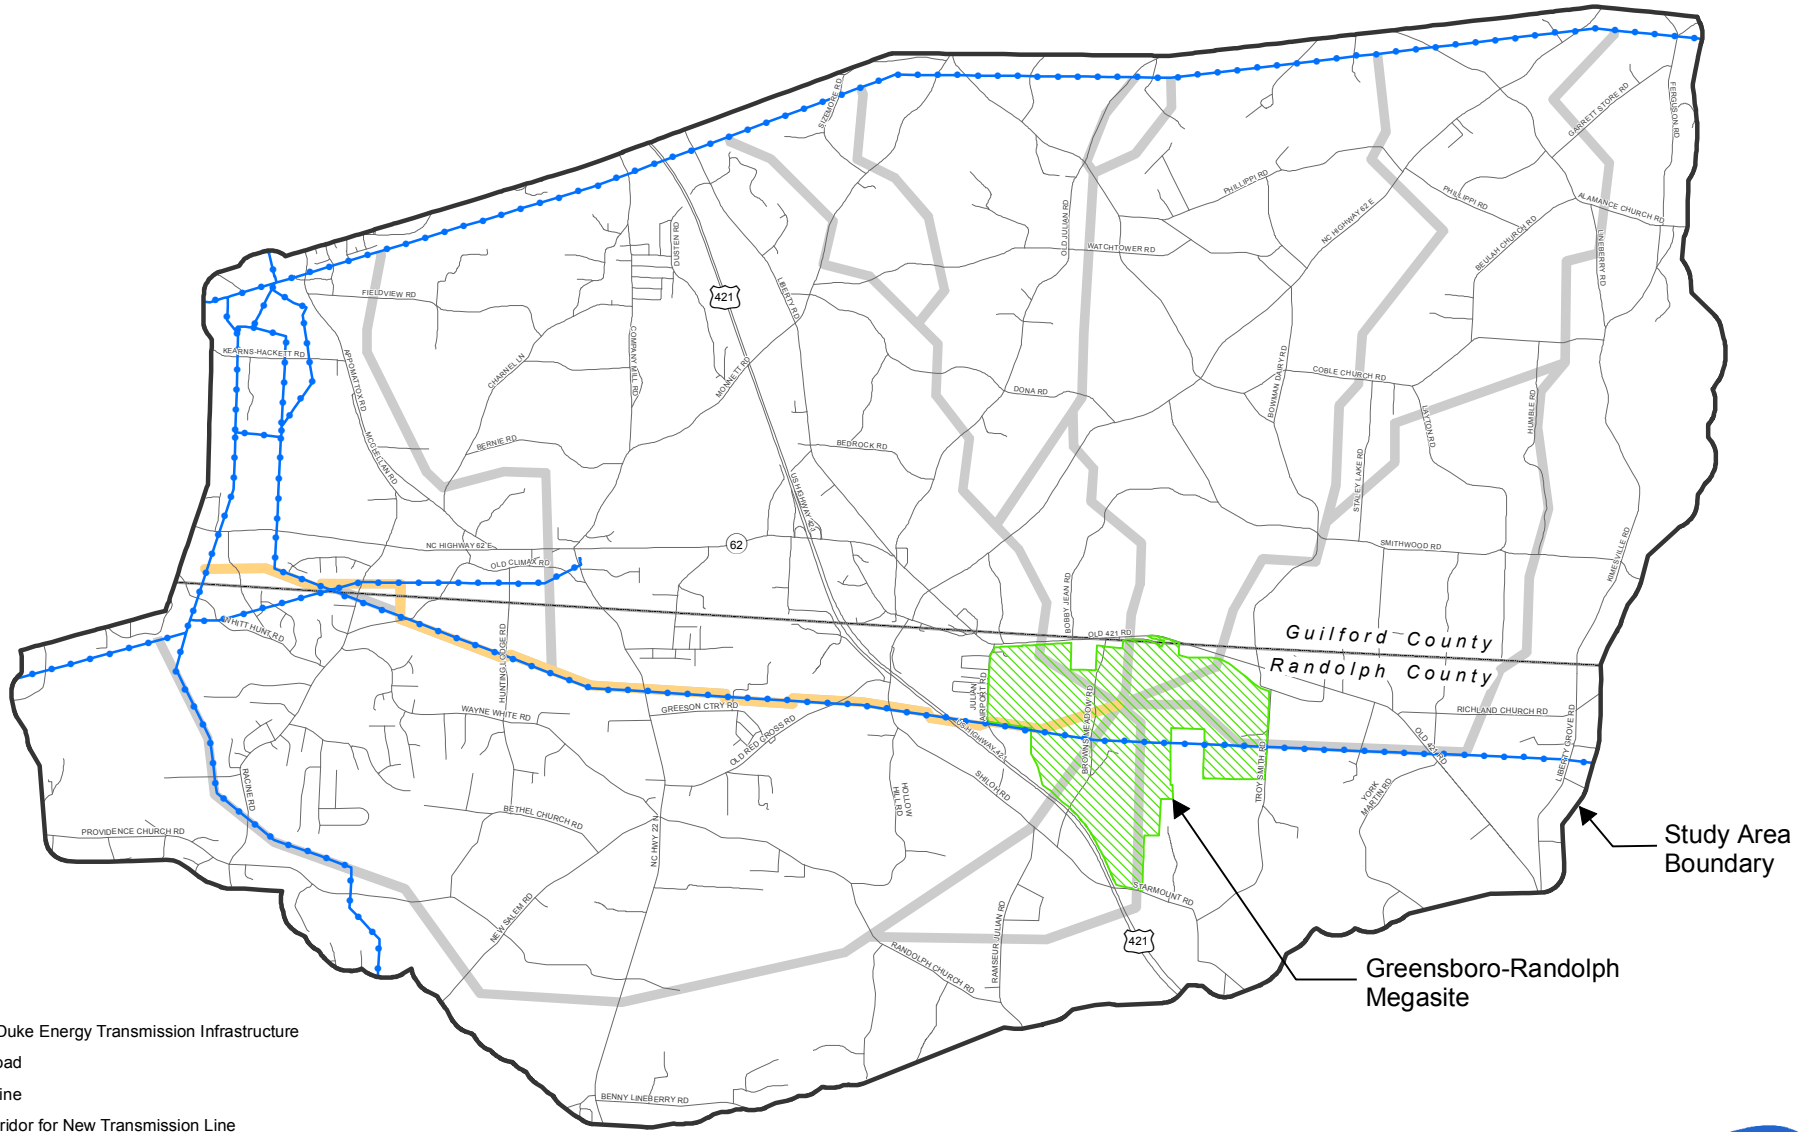

### Legend

- Existing Duke Energy Transmission Infrastructure
- Public Road
- County Line
- Final Corridor for New Transmission Line
- Preliminary Alternative Corridors Not Selected for New Transmission Line
- Greensboro-Randolph Megasite
- Study Area Boundary



### Note:

Selected route and preliminary alternative corridors are shown at a width of 400' for study purposes only. The standard rights-of-way width for a 100kV transmission line is 68 feet. When a new transmission line parallels an existing transmission line the rights-of-way width may be reduced.

